


9/27/06

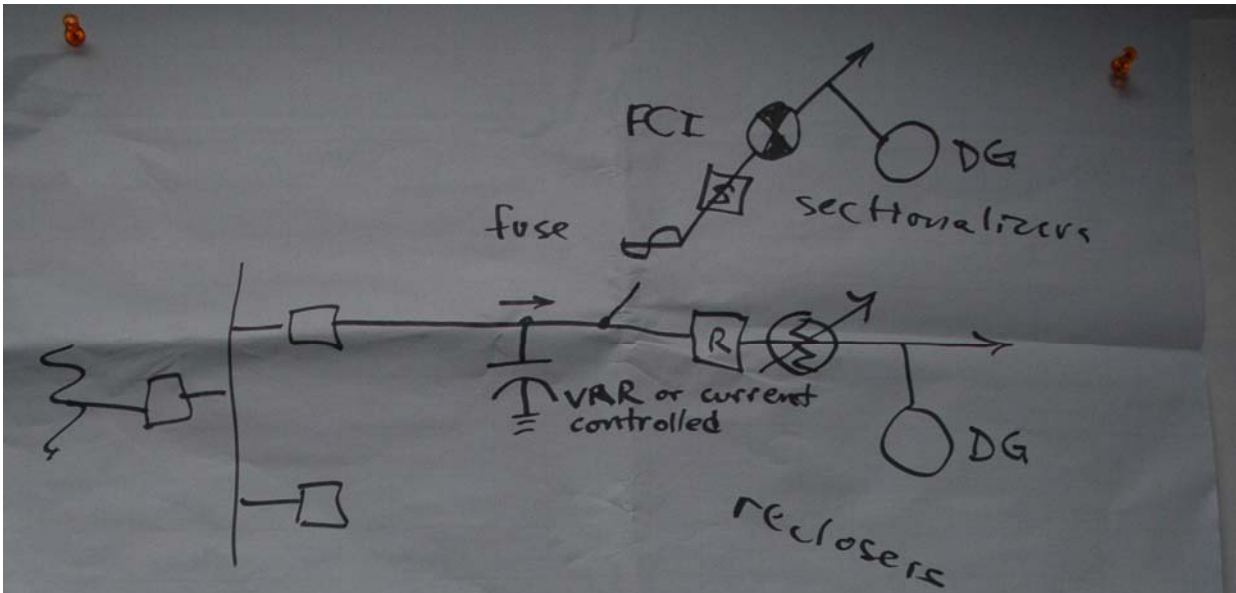

- fault location / troubleshooting ^{device coordination}
- VAR dispatch
- effective grounding
& transformer connections
- voltage regulators